



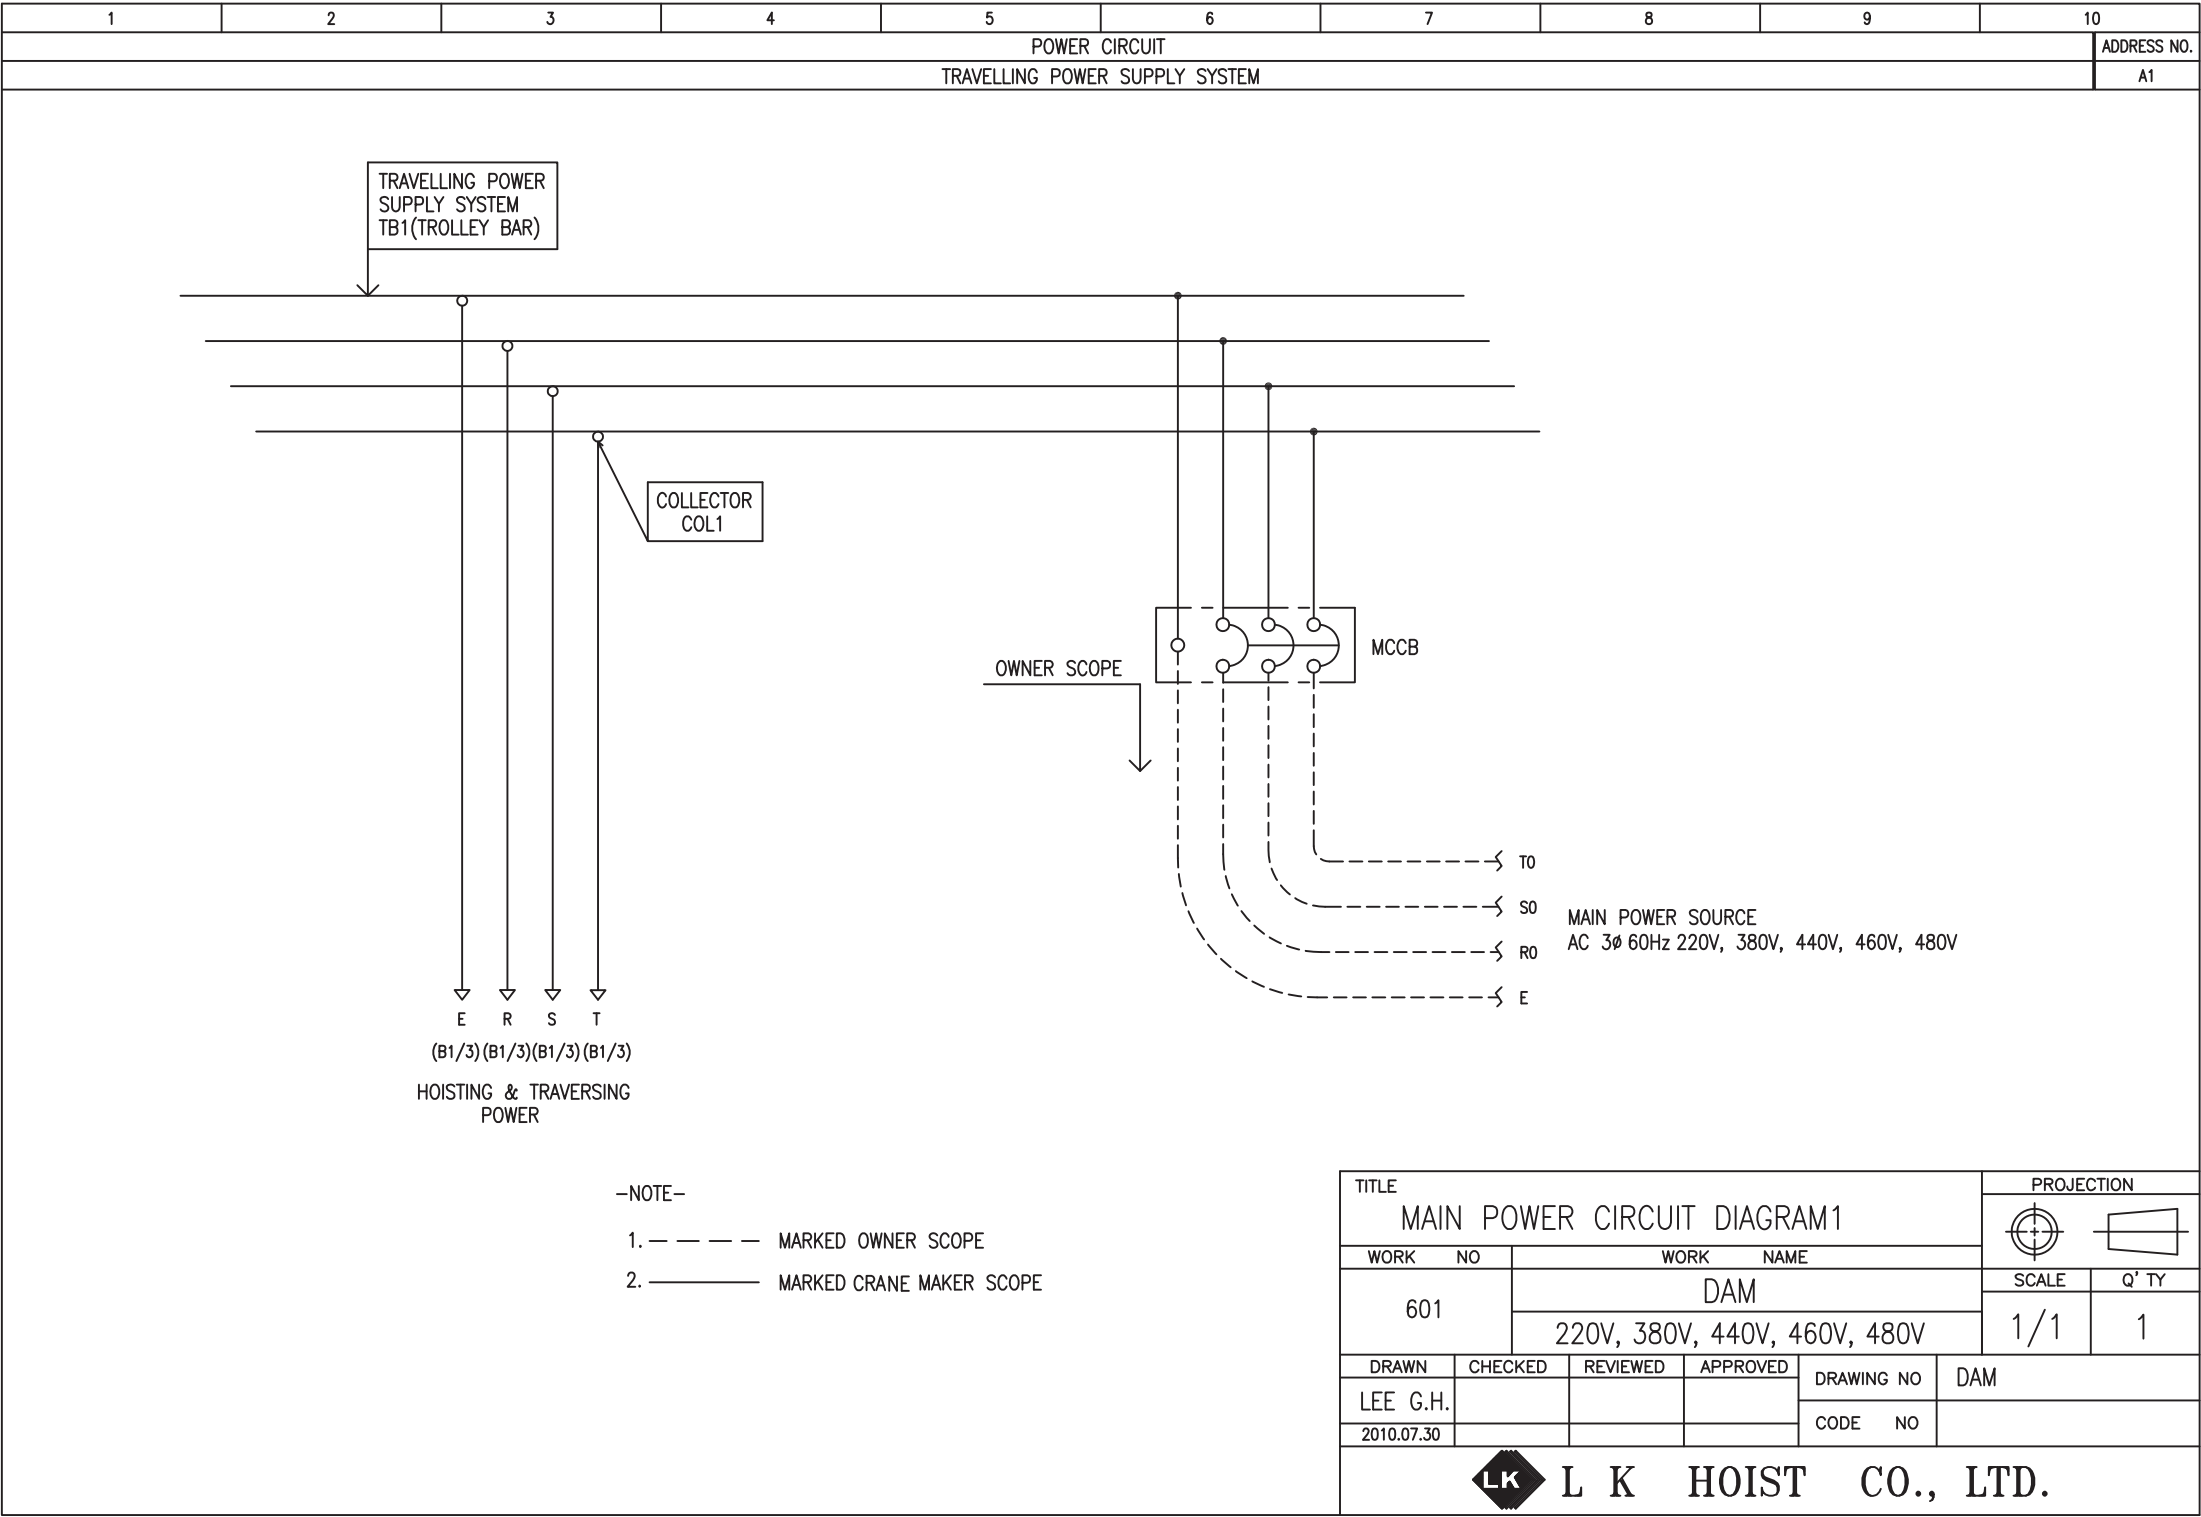


1	2	3	4	5	6	7	8	9	10		
POWER CIRCUIT					CONTROL CIRCUIT					ADDRESS NO.	B1

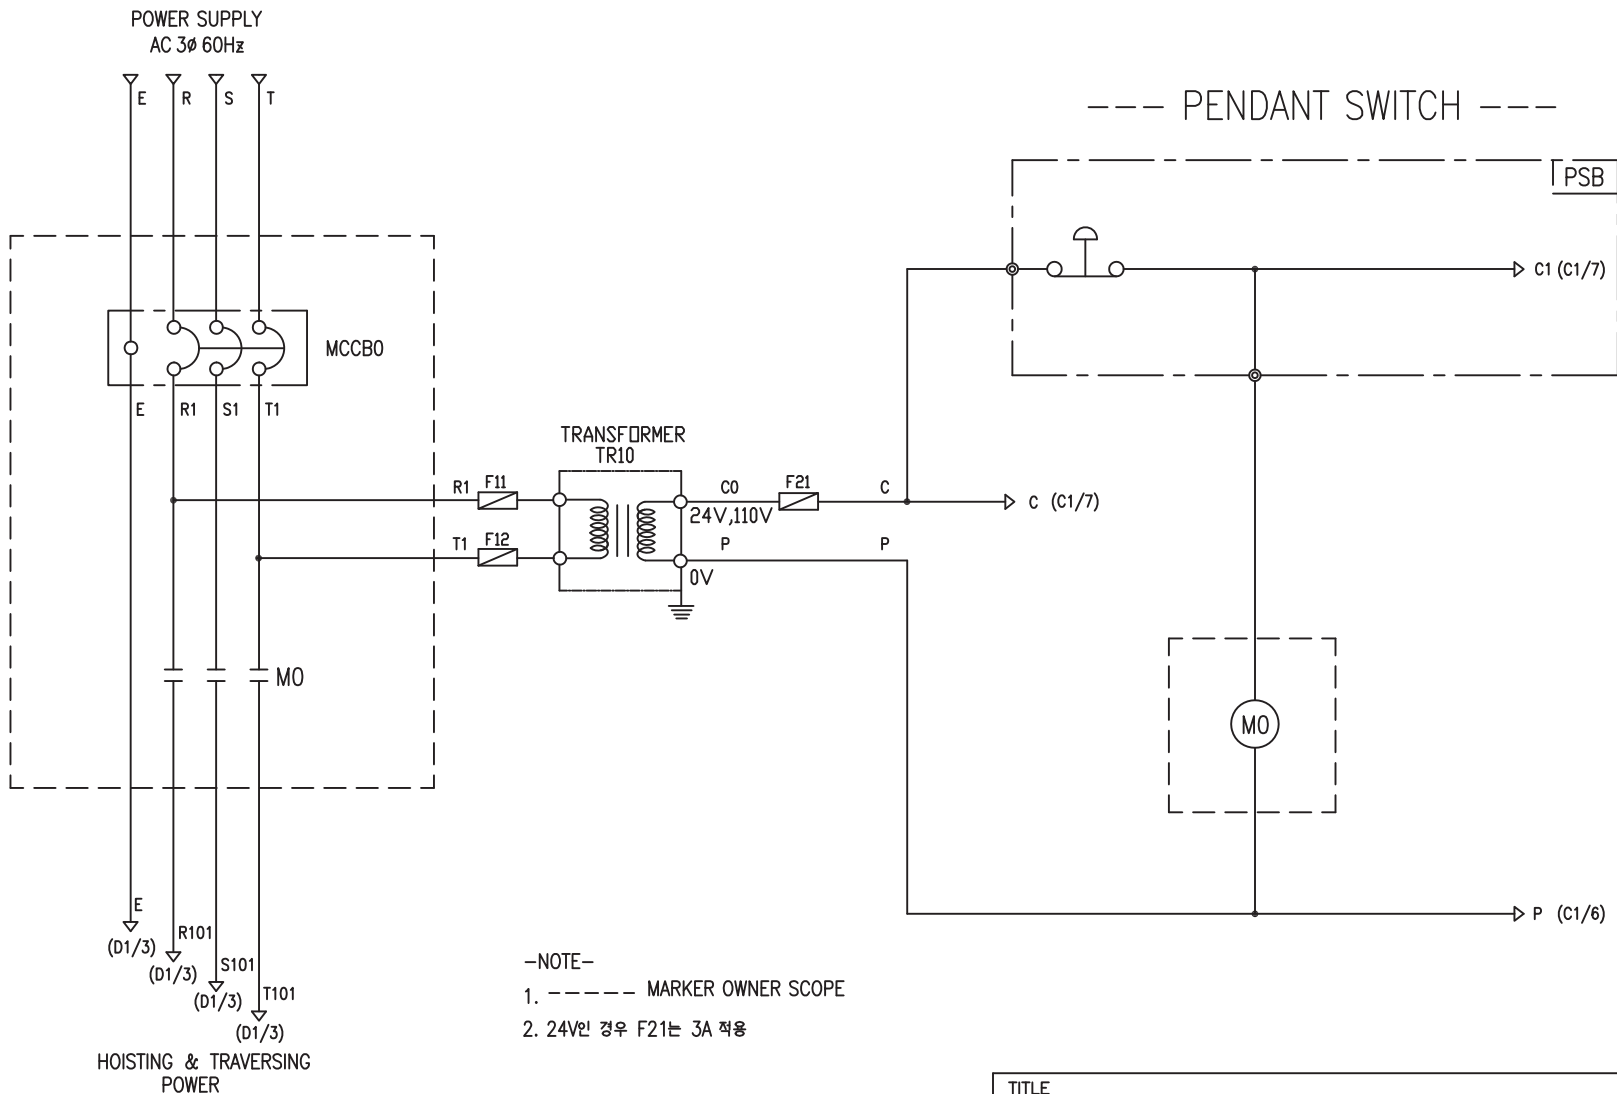

SPECIFICATION	NO FUSE BREAKER		MAGNET CONTACT		TRANSFORMER	FUSE
SYMBOLS	MCCB0		M0		TR10	F11, F12, F21
DESCRIPTION	220V	50A	GMC22	DMC-22	60VA	1A
	380V	30A				
	440V	20A				
	460V	20A				
	480V	20A				
MAKER	LS		LS	DONGA	LK	—

TITLE					PROJECTION	
MAIN POWER & CONTROL CIRCUIT DIAGRAM						
WORK	NO	WORK			NAME	
602		DAM			SCALE	Q' TY
		220V, 380V, 440V, 460V, 480V			1/1	1
DRAWN	CHECKED	REVISED	APPROVED	MODEL	DAM	
LEE.G.H				CODE	NO	
2010.07.30						
 L K HOIST CO., LTD.						

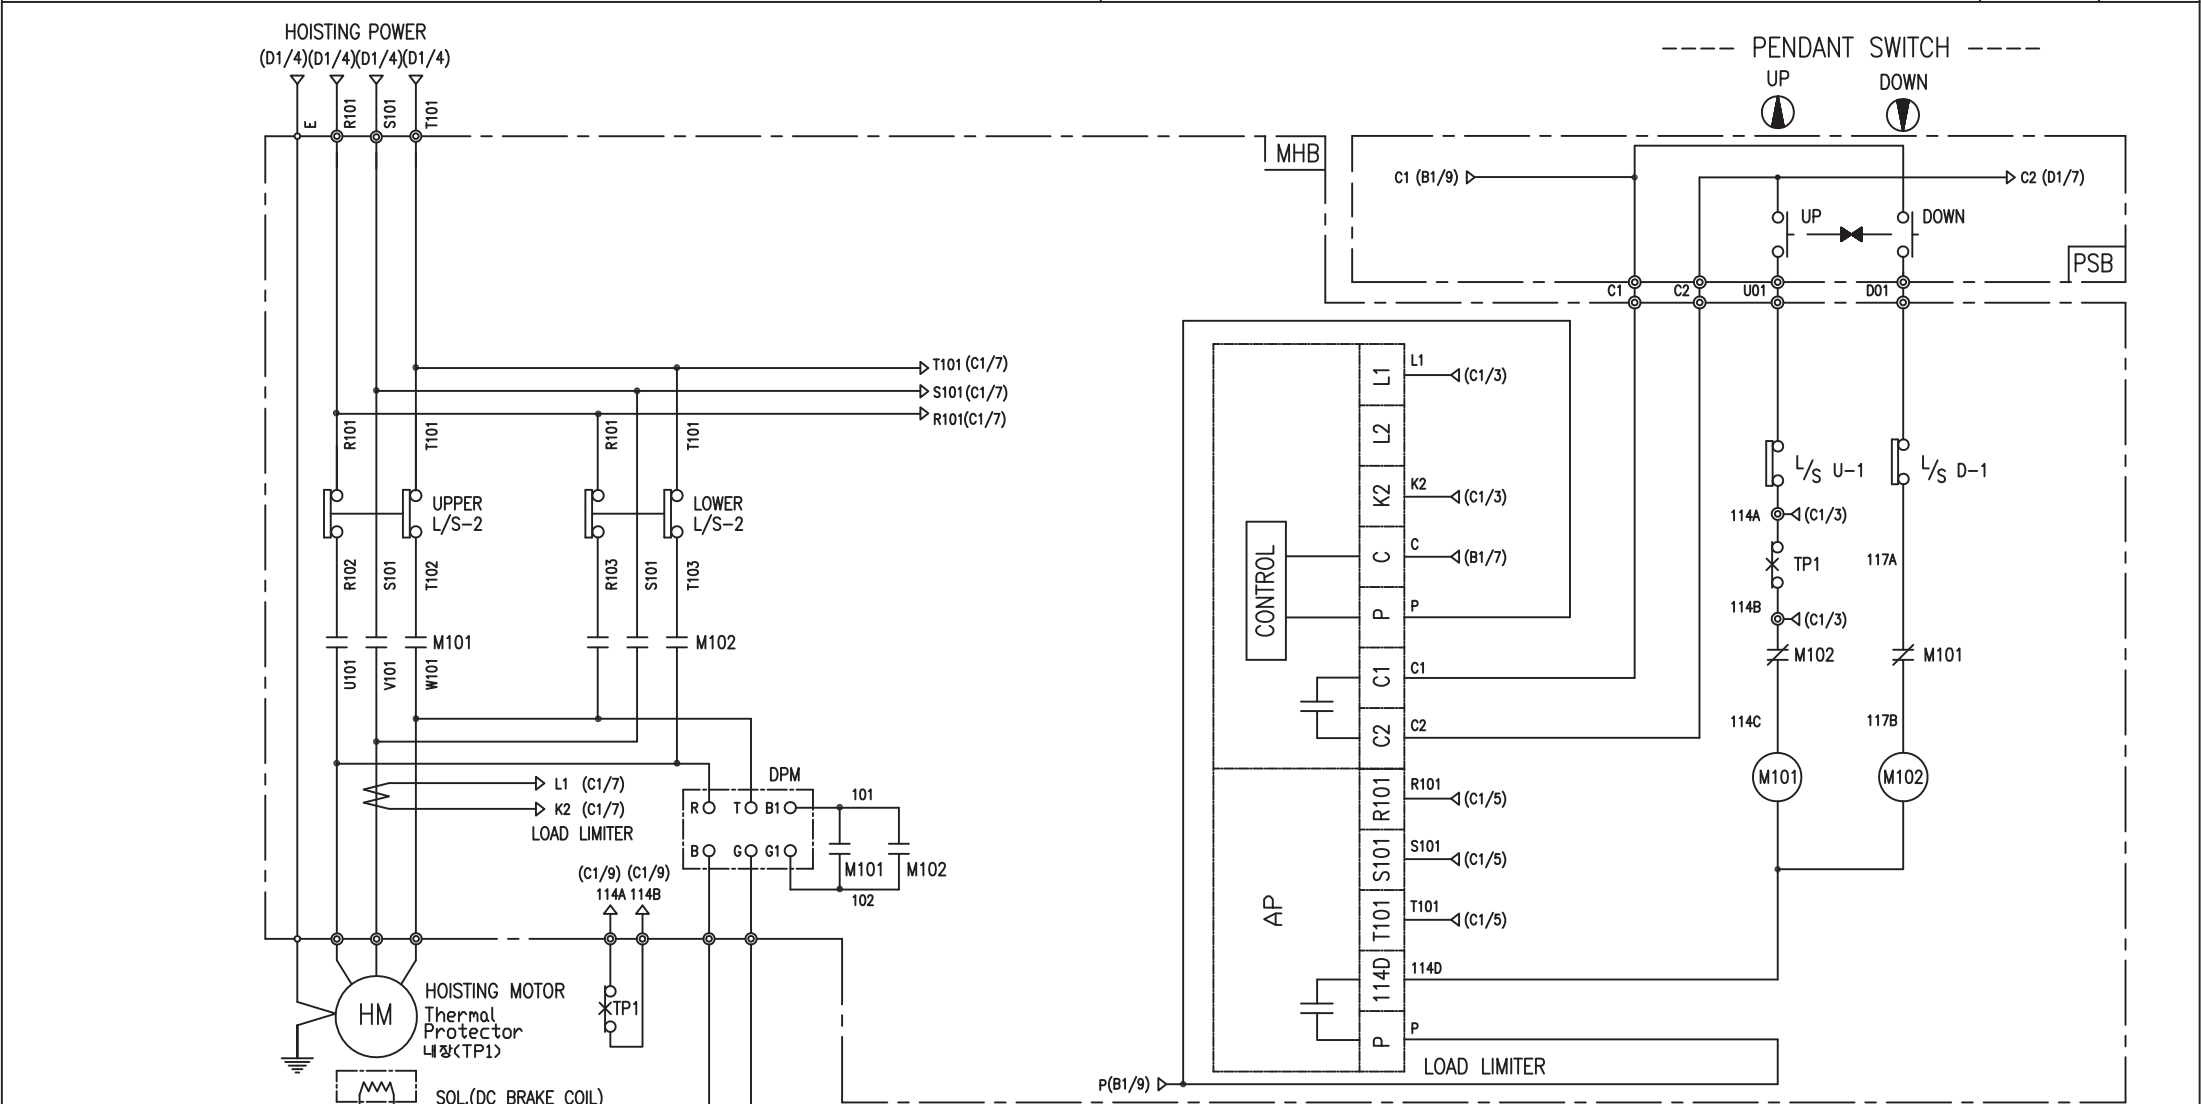

SPECIFICATION	MAGNET CONTACT		LOAD LIMITER	SILICON RECTIFIER				Thermal Protector	HOIST MOTOR
SYMBOLS	M101, M102		-	DPM				TP1	HM
DESCRIPTION	DMC-22	GMC-22	LKDL-601	AC220V	AC440V	AC460V	AC480V	17AM032	3.5Kw * 4P
				DC99V	DC198V	DC207V	DC216V		
MAKER	DONG-A	LS	LK	LK				Texas Instruments	LK

TITLE

HOIST POWER & CONTROL CIRCUIT DIAGRAM

WORK NO

603

WORK NAME

DAM

220V, 440V, 460V, 480V

PROJECTION

SCALE

1/1

Q' TY

1

DRAWN

LEE.G.H

2010.07.30

CHECKED

REVIEWED

APPROVED


MODEL

DAM

LK


L K HOIST CO., LTD.

1	2	3	4	5	6	7	8	9	10		
TRAVERSING POWER CIRCUIT					TRAVERSING CONTROL CIRCUIT					ADDRESS NO.	D1

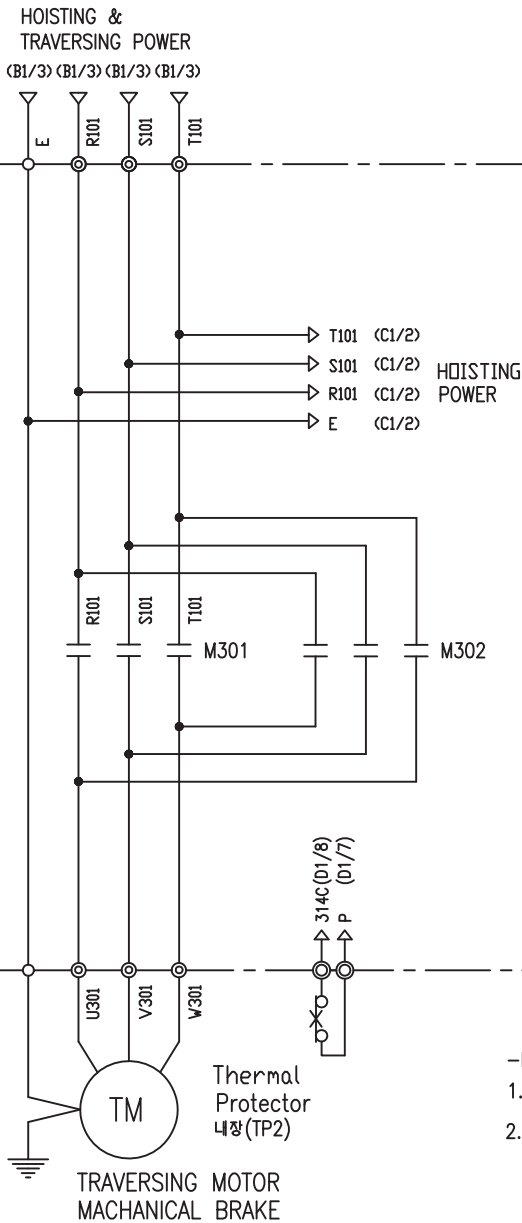

- NOTE—
1.  : Mechanical Interlock
2. ---- : OPTION SCOPE

TITLE TRAVERSING MOTOR POWER & CONTROL CIRCUIT DIAGRAM							PROJECTION	
WORK NO		WORK NAME						
605		DAM					SCALE	Q' TY
		220V, 380V, 440V, 460V, 480V					1/1	1
DRAWN	CHECKED	REVIEWED	APPROVED	MODEL		DAM		
LEE.G.H				CODE NO				
2010.07.30								
 L K HOIST CO., LTD.								

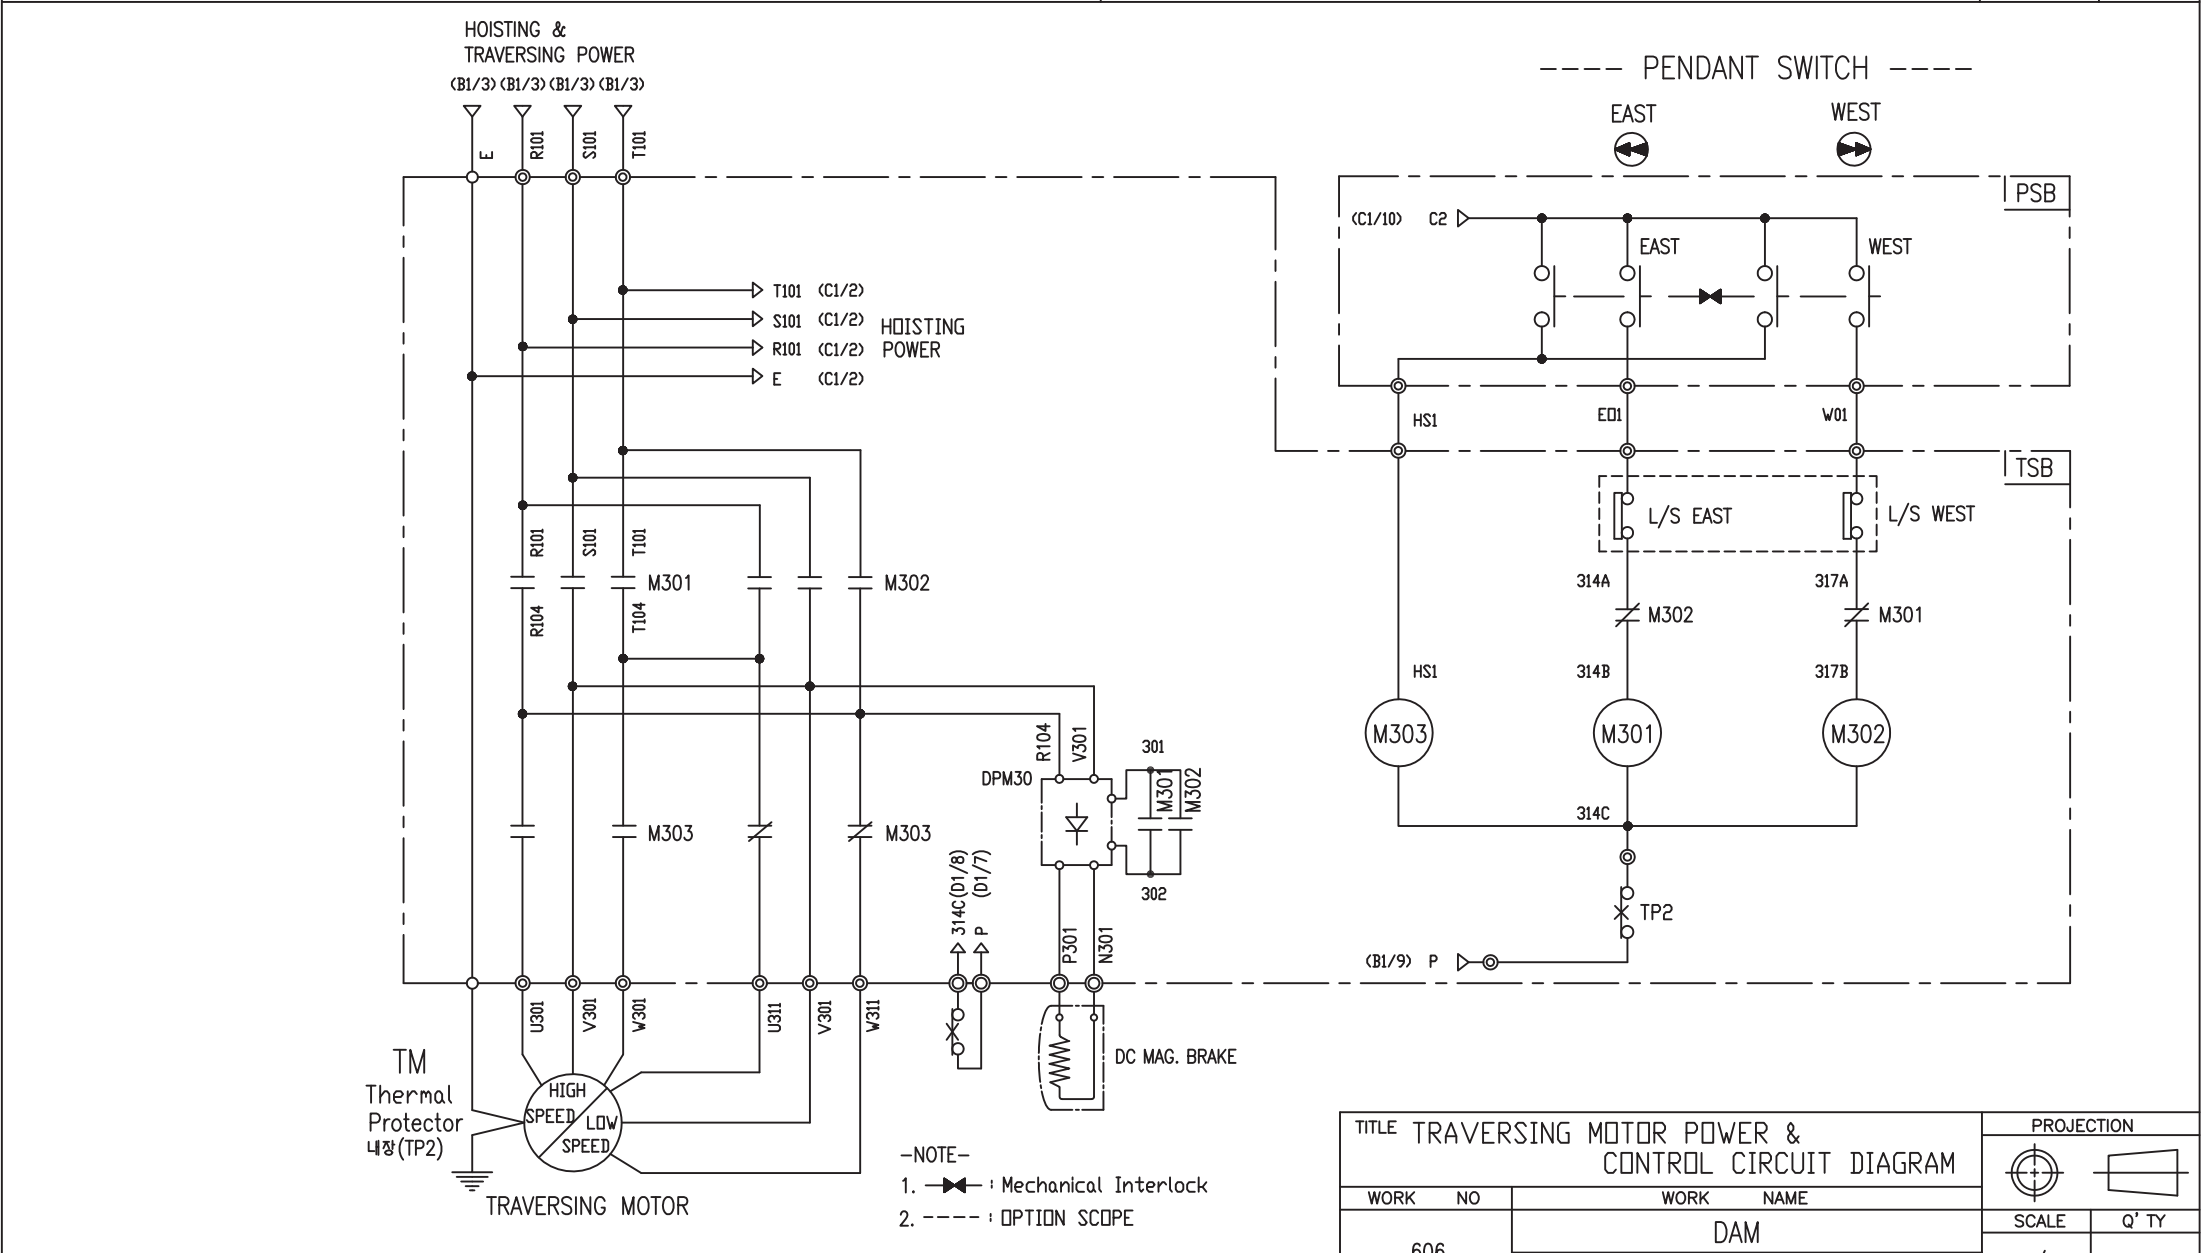

SPECIFICATION	MAGNET CONTACT		Thermal Protector	SILICON RECTIFIER					TRAVERSING MOTOR
SYMBOLS	M301, M302, M303		TP2	DPM30					TM
DESCRIPTION	GMC12	DMC12	17AM032	AC220V	AC380V	AC440V	AC460V	AC480V	0.75/0.25KW *4/12P
				DC99V	DC171V	DC198V	DC207V	DC216V	
MAKER	LS	DONGA	Texas Instruments	LK					LK

TITLE TRAVERSING MOTOR POWER & CONTROL CIRCUIT DIAGRAM

WORK NO. 606

WORK NAME DAM

220V, 380V, 440V, 460V, 480V

PROJECTION

SCALE 1/1

Q' TY 1

DRAWN LEE.G.H

CHECKED

REVIEWED

APPROVED

MODEL DAM

CODE NO

2010.07.30

L K HOIST CO., LTD.

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	HOISTING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	3.5 - 4 - 44	
4. RATED POWER	3.5 KW × 4 P	
5. RATED VOLTAGE AND FREQUENCY	440 V	60HZ
6. MOTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	30 MIN	
8. LOCATION	IN-DOOR , OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	80℃	
11. FULL LOAD SPEED	1740 RPM	
12. FULL LOAD CURRENT	8.6 A	
13. STARTING CURRENT AT RATED VOLTAGE	46.4 A	
14. MINIMUM STARTING VOLTAGE	396 V	
15. EFFICIENCY AT 100% RATED LOAD	73.3 %	
16. POWER FACTOR AT 100% RATED LOAD	72.8 %	
17. STARTING TORQUE	245 %	
18. TYPE OF ENCLOSURE	전폐형(IP-54)	
19. TYPE OF BEARING	PL : 6205DD OPL : 6008ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	TRAVERSING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	0.75 - 4 - 44	
4. RATED POWER	0.75 KW × 4 P	
5. RATED VOLTAGE AND FREQUENCY	440 V 60HZ	
6. MOTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	15 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	100℃	
11. FULL LOAD SPEED	1670 RPM	
12. FULL LOAD CURRENT	2.4 A	
13. STARTING CURRENT AT RATED VOLTAGE	13.2 A	
14. MINIMUM STARTING VOLTAGE	396 V	
15. EFFICIENCY AT 100% RATED LOAD	65 %	
16. POWER FACTOR AT 100% RATED LOAD	63 %	
17. STARTING TORQUE	249 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6008DD OPL : 6207ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	TRAVERSING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	0.4 - 6 - 44	
4. RATED POWER	0.4 KW × 6 P	
5. RATED VOLTAGE AND FREQUENCY	440 V 60HZ	
6. ROTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	15 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	100℃	
11. FULL LOAD SPEED	1140 RPM	
12. FULL LOAD CURRENT	1.6 A	
13. STARTING CURRENT AT RATED VOLTAGE	8.8 A	
14. MINIMUM STARTING VOLTAGE	396 V	
15. EFFICIENCY AT 100% RATED LOAD	65 %	
16. POWER FACTOR AT 100% RATED LOAD	63 %	
17. STARTING TORQUE	250 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6008DD OPL : 6207ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPERATURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	

SPECIFICATION FOR ELECTRIC MOTORS	INTERNAL IDENTIFICATION NO.	PAGE : REV :
SCHEDULE OF TECHNICAL DATA		
1. SERVICE	TRAVERSING	
2. MANUFACTURE	LK HOIST CO. LTD	
3. MOTOR MODEL NO	0.75/0.25 - 4/12 - 44	
4. RATED POWER	0.75/0.25 KW × 4/12 P	
5. RATED VOLTAGE AND FREQUENCY	440 V	60HZ
6. MOTOR TYPE	SQUIRREL CAGE ROTOR TYPE	
7. RATING	15 MIN	
8. LOCATION	OUTDOOR	
9. INSULATION CLASS	B	
10. DESIGN TEMPERATURE RISE (BY RESISTANCE)	100℃	
11. FULL LOAD SPEED	1670 / 550 RPM	
12. FULL LOAD CURRENT	2.4 / 1.5 A	
13. STARTING CURRENT AT RATED VOLTAGE	13.2 / 8.25 A	
14. MINIMUM STARTING VOLTAGE	396 V	
15. EFFICIENCY AT 100% RATED LOAD	65 / 48 %	
16. POWER FACTOR AT 100% RATED LOAD	63 / 46 %	
17. STARTING TORQUE	250 / 243 %	
18. TYPE OF ENCLOSURE	전폐형	
19. TYPE OF BEARING	PL : 6008DD OPL : 6207ZZ	
20. MOUNTING	VERTICAL	
21. MAXIMUM AMBIENT TEMPURE	40℃	
22. BEARING LUBRICATION	GREASE	
23. STARTING METHOD	FULL VOLTAGE	